


Use 20 / 2 AWG  
solid core cable

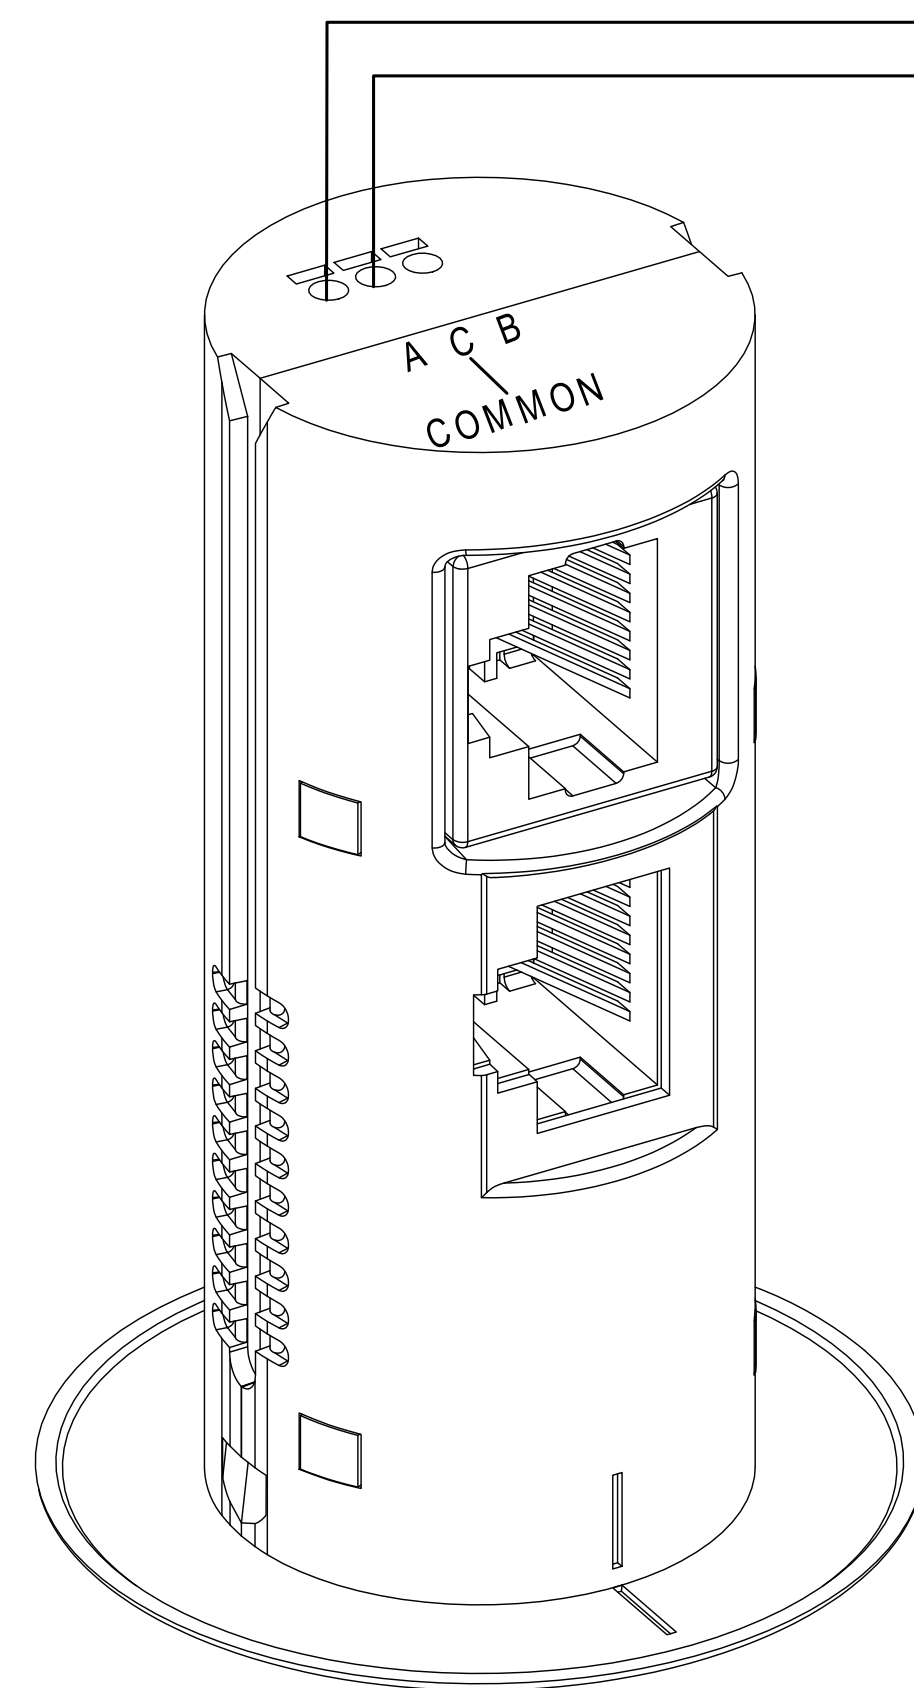


SPST  
(ON-OFF) SWITCH

NOTE:  
For this application,  
connect to either  
A and C  
or  
B and C  
on the Smartsensor  
GPIO terminals

## SMARTSENSOR 3G

Use 20 / 3 AWG  
solid core cable

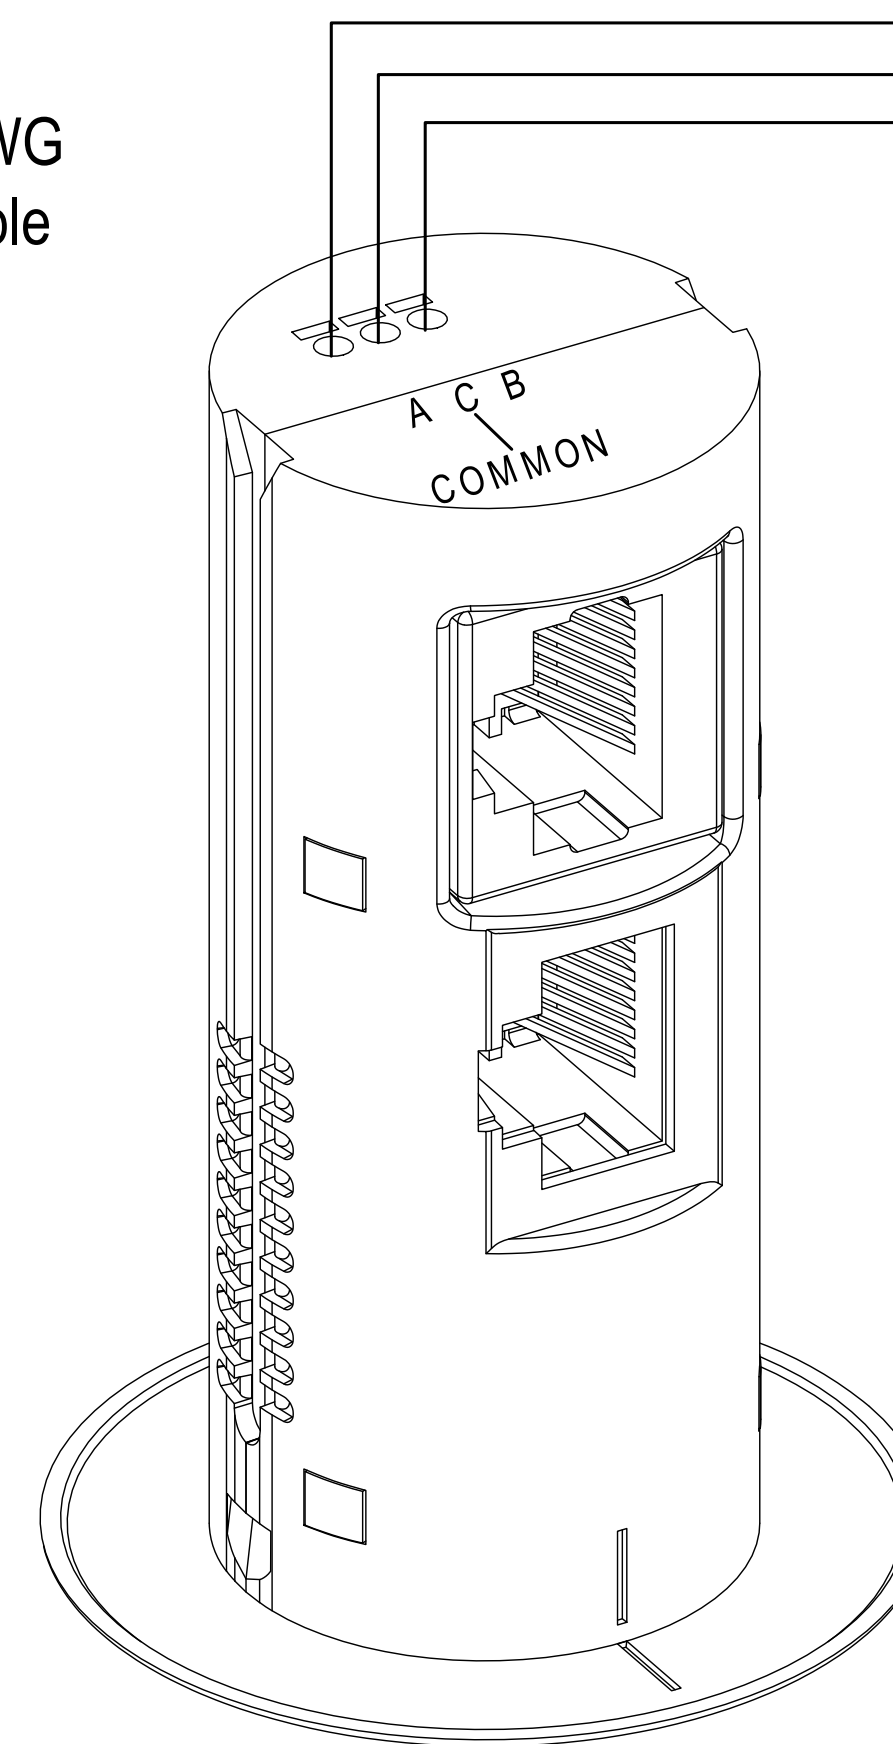


SPDT MOMENTARY CONTACT  
(ON - OFF - ON) SWITCH

NOTES:  
For this application, connect to  
all three GPIO terminals of the  
Smartsensor.  
The connectivity at the switch  
end to be determined by the  
project specifier.

## SMARTSENSOR 3G

# SMARTSENSOR GPIO SWITCH DIAGRAM

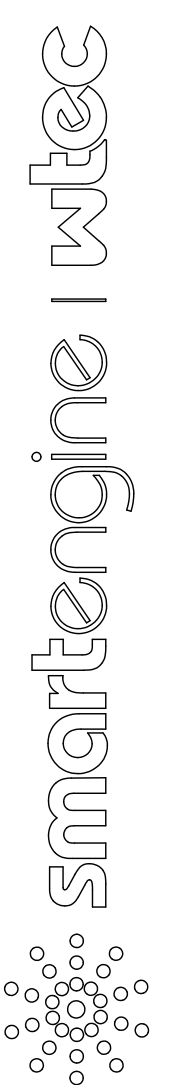

THE INFORMATION CONTAINED  
IN THIS DRAWING IS  
CONFIDENTIAL AND THE SOLE  
PROPERTY OF wtec GmbH.  
ITS CONTENTS MAY NOT BE  
DISCLOSED OR REPRODUCED, IN  
PART OR AS A WHOLE, WITHOUT  
PRIOR WRITTEN PERMISSION OF  
wtec GmbH.

DRAWN BY	RELEASE NO.
EJD	1.1
SCALE	DATE
NA	09/30/20

SHEET NO.

SE-SL04